



CUSTOMER TO SUPPLY PROPER BRANCH
CIRCUIT PROTECTION AS PER LOCAL CODES.
(USE 75°C COPPER WIRE ONLY)

INCOMING POWER
480V 3Ø 60HZ

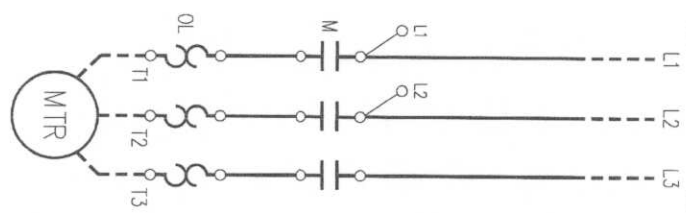

480V

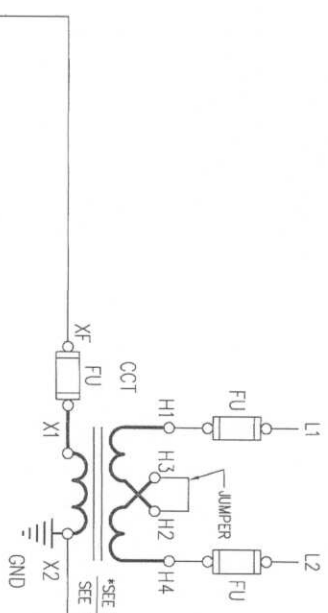

*SEE SPECIFIC ORDER FOR PRIMARY VOLTAGE

BXXXXT213JK TYPE XFMER	
PRIMARY CONNECTIONS	
VOLTAGE	JUMPER
220/230/240	H1 H4 H1 H3/H2 H4
440/460/480	H1 H4 H3 H2
SECONDARY CONNECTIONS	
110/115/120V	X1 X2 NA

*SEE TABLE
SEE TABLE

TERM. BLOCK DETAIL



- NOTES:
- 1) TB JUMPER TO BE REMOVED IF INTERLOCK SWITCH IS USED.
 - 2) X2 TERMINAL GROUNDED AS STANDARD, REMOVE IF NOT REQUIRED.
 - 3) X2 TERMINAL GROUNDED AS STANDARD, REMOVE IF NOT REQUIRED.

NOTICE

THIS DRAWING IS THE CONFIDENTIAL
PROPERTY OF SPRECHER-SCHUH, INC.
and, as such, is subject to recall at
any time. The drawing may not be
reproduced, used or disclosed for
any purpose except as authorized by
SPRECHER-SCHUH, INC.

DRAWN BY:	MB
CHECKED BY:	MB
APPROVED BY:	MH
DATE	

CUSTOM CONTROL PANEL
FVNR W/ TB'S FOR INTERLOCK SWITCH
PART NUMBER - 2971C-P
AUBURN ARMATURE - MORSE MFG

sprecher+
schuh HOUSTON,
DWG. NO. CCP WS-615-984
SHEET 3 OF 3