



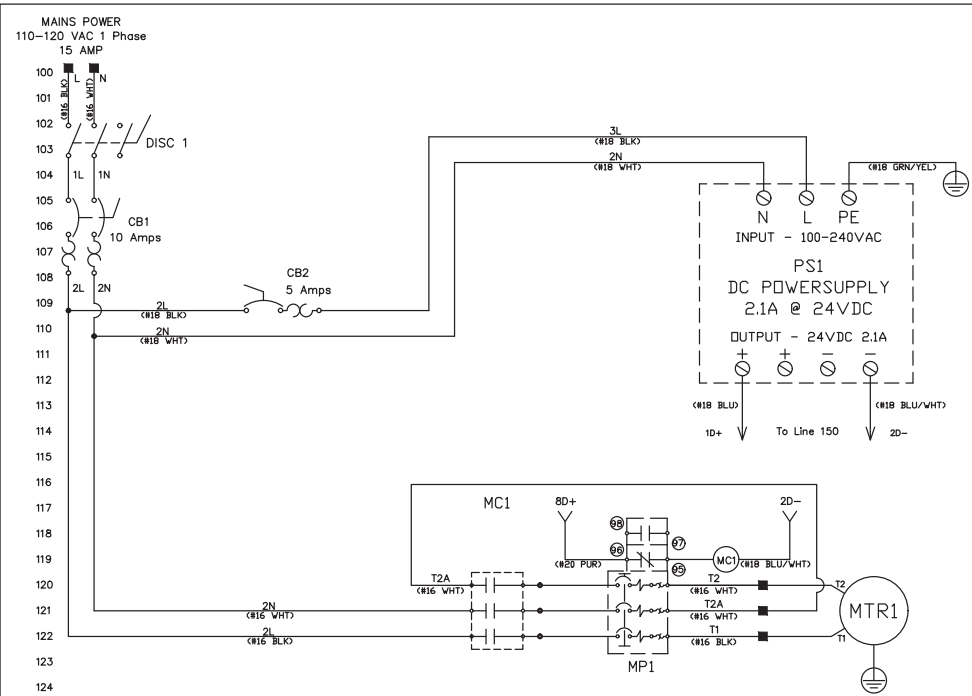

*MANUFACTURER	*PART NUMBER	DESCRIPTION	QUANTITY
Iboco	T1-0510G	WIRE DUCT	1
Iboco	OMEGA 3FAL1	DIN Rail	1
Eurobox (EXM)	5412 ESH141208	Enclosure, NEMA 4-12, 14" x 12" x 8"	1
		Electrical Hazard Warning Label	1
Mencom	PCG-1/2X	Cable Gland	1
Mencom	PCG-1/2	Cable Gland	2
Mencom	212PA	Nut	3
Autonics	LE4S	Digital Timer, 24-240VAC/VDC, Relay Output	1
Autonics	PG-08	8-Pin Socket	1
Lutze	DRAN60-24A	Power Supply, Input 100-240VAC, Output 24VDC, 60W	1
Schmersal	SRB-E-201LC	Safety Relay Module	1
Sprecher+Schuh	CA8-12C-10-24D	Contactors	1
Sprecher+Schuh	CA8-P11	Auxiliary Contact Block, 1NO/1NC	1
Sprecher+Schuh	CT8-B75	Overload Relay, 5.5 to 7.5 Amps	1
Sprecher+Schuh	D7P-E202PX01	Pushbutton, Extended Black "STOP", 1NC	1
Sprecher+Schuh	D7P-F301PX10	Pushbutton, Flush Green "START", 1NO	1
Sprecher+Schuh	D7P-MT44	E-Stop Operator, Twist-To-Release, 40mm	1
Sprecher+Schuh	D7-ALP	Latch, Plastic	1
Sprecher+Schuh	D7-X01	Contact Block, NC	2
Sprecher+Schuh	D7-15YSE112	E-Stop Inscription Ring	1
Sprecher+Schuh	LA7-16-1753	Base Mounted 3 Pole Switch	1
Sprecher+Schuh	LF52-G-5-175	Switch Handle Assembly	1
Sprecher+Schuh	LA2-G3393	Metal Operating Shaft	1
Sprecher+Schuh	L9-10/2/D	Circuit Breaker, 10Amp, D-Curve	1
Sprecher+Schuh	L8-5/1/B	Circuit Breaker, 5 Amp, B-Curve	1
Sprecher+Schuh	L8-2/1/B	Circuit Breaker, 2 Amp, B-Curve	1
Sprecher+Schuh	V7-WG4	Ground Terminal	1
Sprecher+Schuh	V7-W4	Terminal	5
Sprecher+Schuh	V7-WD4	Terminal	4
Sprecher+Schuh	V7-EA35	End Anchor	9
Sprecher+Schuh	V7-EB3	End Barrier	1
Sprecher+Schuh	V7-EBD3	End Barrier	2
Sprecher+Schuh	V7-PP3	Partition	1
Sprecher+Schuh	V7-SM6X9	Marker Card	1
Sprecher+Schuh	V7-SM6X12	Marker Card	1
Sprecher+Schuh	V7-CJD6-2	Center Jumper	1
		Legend Plate, 0.75" x 0.75", "0/STOP"	1
		Legend Plate, 0.75" x 0.75", "1/START"	1

TIMER SETTINGS		
PARAMETER	DISPLAY	SETTING
Output operation mode	alt'n	and
Time Range	trn	99'59"
Time UP/DOWN	U-d	dn
Width of min. input signal	1 nt	20
Backlight	blu	on
Key lock	lock	off

*FUNCTIONALLY EQUIVALENT COMPONENTS MAY BE SUBSTITUTED

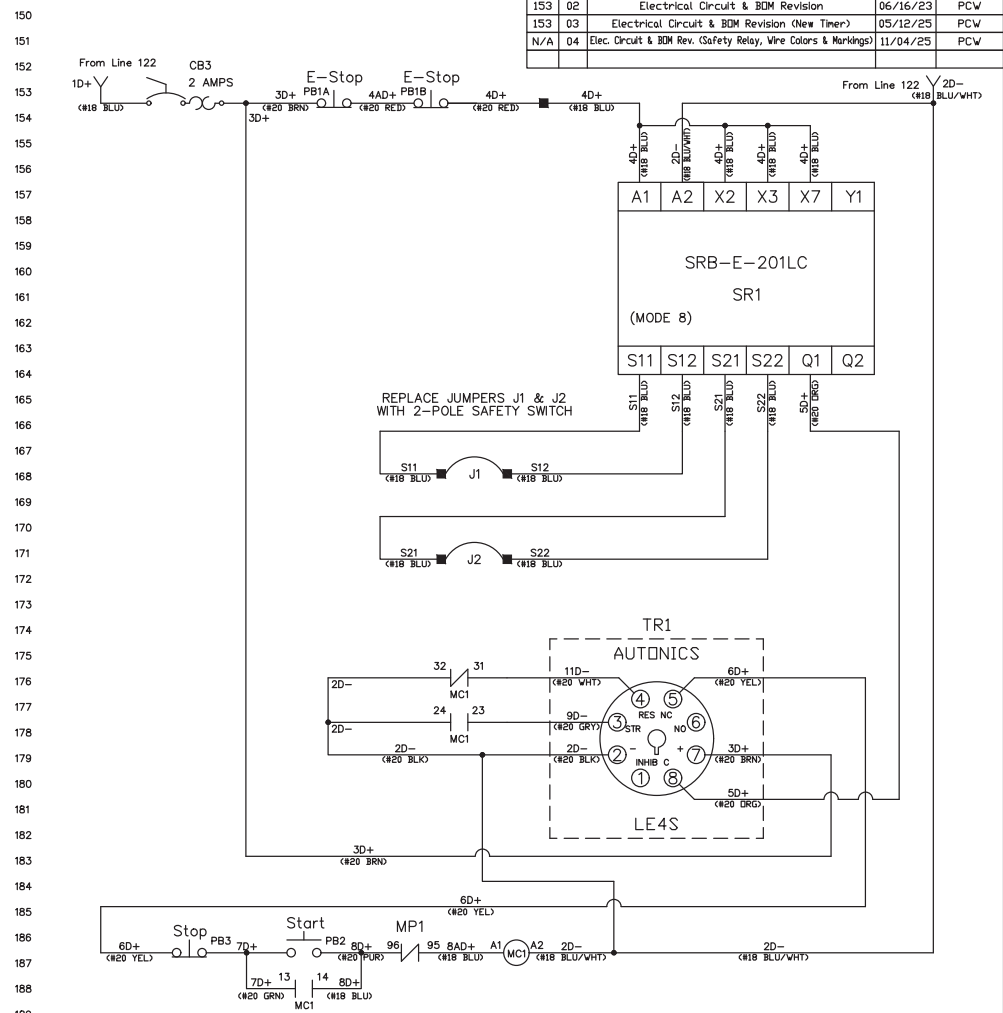

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
N/A	01	Timer Setting Change	08/04/21	PCW
153	02	Electrical Circuit & BDM Revision	06/16/23	PCW
153	03	Electrical Circuit & BDM Revision (New Timer)	05/12/25	PCW
N/A	04	Elec. Circuit & BDM Rev. (Safety Relay, Wire Colors & Markings)	11/04/25	PCW

DRAWN BY
PCW

CHD BY
PCW

DATE DRAWN
02/26/18

DATE CHD
11/04/25

MORSE

The Specialist In Drum Handling Equipment

103 Kuhn Rd, Syracuse, NY 13208
PHONE 315-564-4347 FAX 315-437-1029

TITLE
MORSE 6000-P (ELECTRICAL)

DWG NO.
AACI022618B

SHEET
1 of 1

REV
04

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF MORSE MANUFACTURING COMPANY INC. AND MUST BE RETURNED TO MORSE MANUFACTURING COMPANY INC. IMMEDIATELY UPON REQUEST. NO REPRODUCTION OR DISTRIBUTION OF THIS MATERIAL IS PERMITTED WITHOUT THE WRITTEN CONSENT OF MORSE MANUFACTURING COMPANY INC.