



MAINS POWER
380-460 VAC 3 Phase
15 AMP

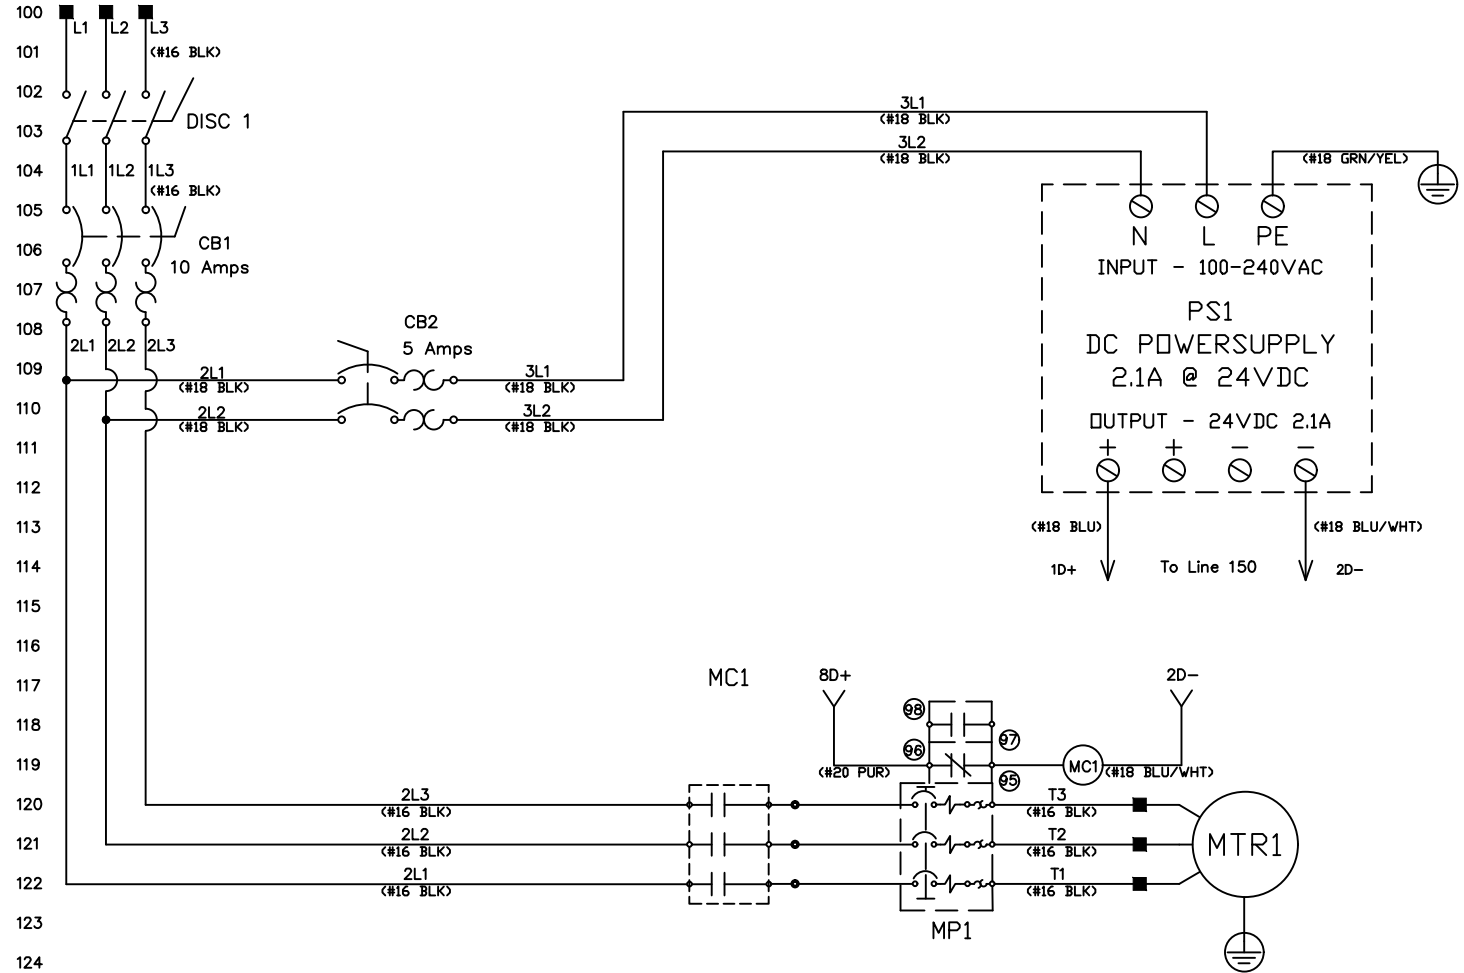

*MANUFACTURER	*PART NUMBER	DESCRIPTION	QUANTITY
Iboco	T1-0510G	WIRE DUCT	1
Iboco	OMEGA 3FAL1	DIN Rail	1
Eurobex (EXM)	5412 ESCH141208	Enclosure, NEMA 4-12, 14" x 12" x 8"	1
		Electrical Hazard Warning Label	1
Mencom	PCG-1/2X	Cable Gland	1
Mencom	PCG-1/2	Cable Gland	2
Mencom	212PA	Nut	3
Autonics	LE4S	Digital Timer, 24-240VAC/VDC, Relay Output	1
Autonics	PG-08	8-Pin Socket	1
Sprecher+Schuh	FLEX9024B	Power Supply, Input 230/460VAC, Output 24VDC @5A	1
Schmersal	SRB-E-201LC	Safety Relay Module	1
Sprecher+Schuh	CA7-9E-10-24E	Contact	1
Sprecher+Schuh	CA7-PV-S11	Auxiliary Contact Block, 1NO/1NC	1
Sprecher+Schuh	CEP7-1EEBB	Overload Relay, 0.2 to 1.0A	1
Sprecher+Schuh	D7P-E202PX01	Pushbutton, Extended Black "STOP", 1NC	1
Sprecher+Schuh	D7P-F301PX10	Pushbutton, Flush Green "START", 1NO	1
Sprecher+Schuh	D7P-MT44	E-Stop Operator, Twist-To-Release, 40mm	1
Sprecher+Schuh	D7-ALP	Latch, Plastic	1
Sprecher+Schuh	D7-X01	Contact Block, NC	2
Sprecher+Schuh	D7-15YSE112	E-Stop Inscription Ring	1
Sprecher+Schuh	LA7-16-1753	Base Mounted 3 Pole Switch	1
Sprecher+Schuh	LFS2-G-6-175	Switch Handle Assembly	1
Sprecher+Schuh	LA2-G3393	Metal Operating Shaft	1
Sprecher+Schuh	L9-10/3/D	Circuit Breaker, 10Amp, D-Curve	1
Sprecher+Schuh	L8-5/2/B	Circuit Breaker, 5 Amp, B-Curve	1
Sprecher+Schuh	L8-2/1/B	Circuit Breaker, 2 Amp, B-Curve	1
Sprecher+Schuh	V7-WG4	Ground Terminal	1
Sprecher+Schuh	V7-W4	Terminal	7
Sprecher+Schuh	V7-WD4	Terminal	6
Sprecher+Schuh	V7-EA35	End Anchor	9
Sprecher+Schuh	V7-EB3	End Barrier	1
Sprecher+Schuh	V7-EBD3	End Barrier	2
Sprecher+Schuh	V7-PP3	Partition	3
Sprecher+Schuh	V7-SM6X9	Marker Card	1
Sprecher+Schuh	V7-SM6X12	Marker Card	1
Sprecher+Schuh	V7-CJD6-2	Center Jumper	2
		Legend Plate, 0.75" x 0.75", "O/STOP"	1
		Legend Plate, 0.75" x 0.75", "I/START"	1
*FUNCTIONALLY EQUIVALENT COMPONENTS MAY BE SUBSTITUTED			

TIMER SETTINGS		
PARAMETER	DISPLAY	SETTING
Output operation mode	auto	and
Time Range	turn	99h59m
Time UP/DOWN	U-d	dn
Width of min. input signal	1 nt	20
Backlight	blu	on
Key lock	LOCK	LoFF

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
153	01	ELECTRICAL REVISION	02/26/24	PCW
155	02	ELECTRICAL & BDM REVISION (NEW TIMER)	04/01/25	PCW
N/A	03	ELECTRICAL & BDM REVISION (SAFETY RELAY)	01/12/26	PCW

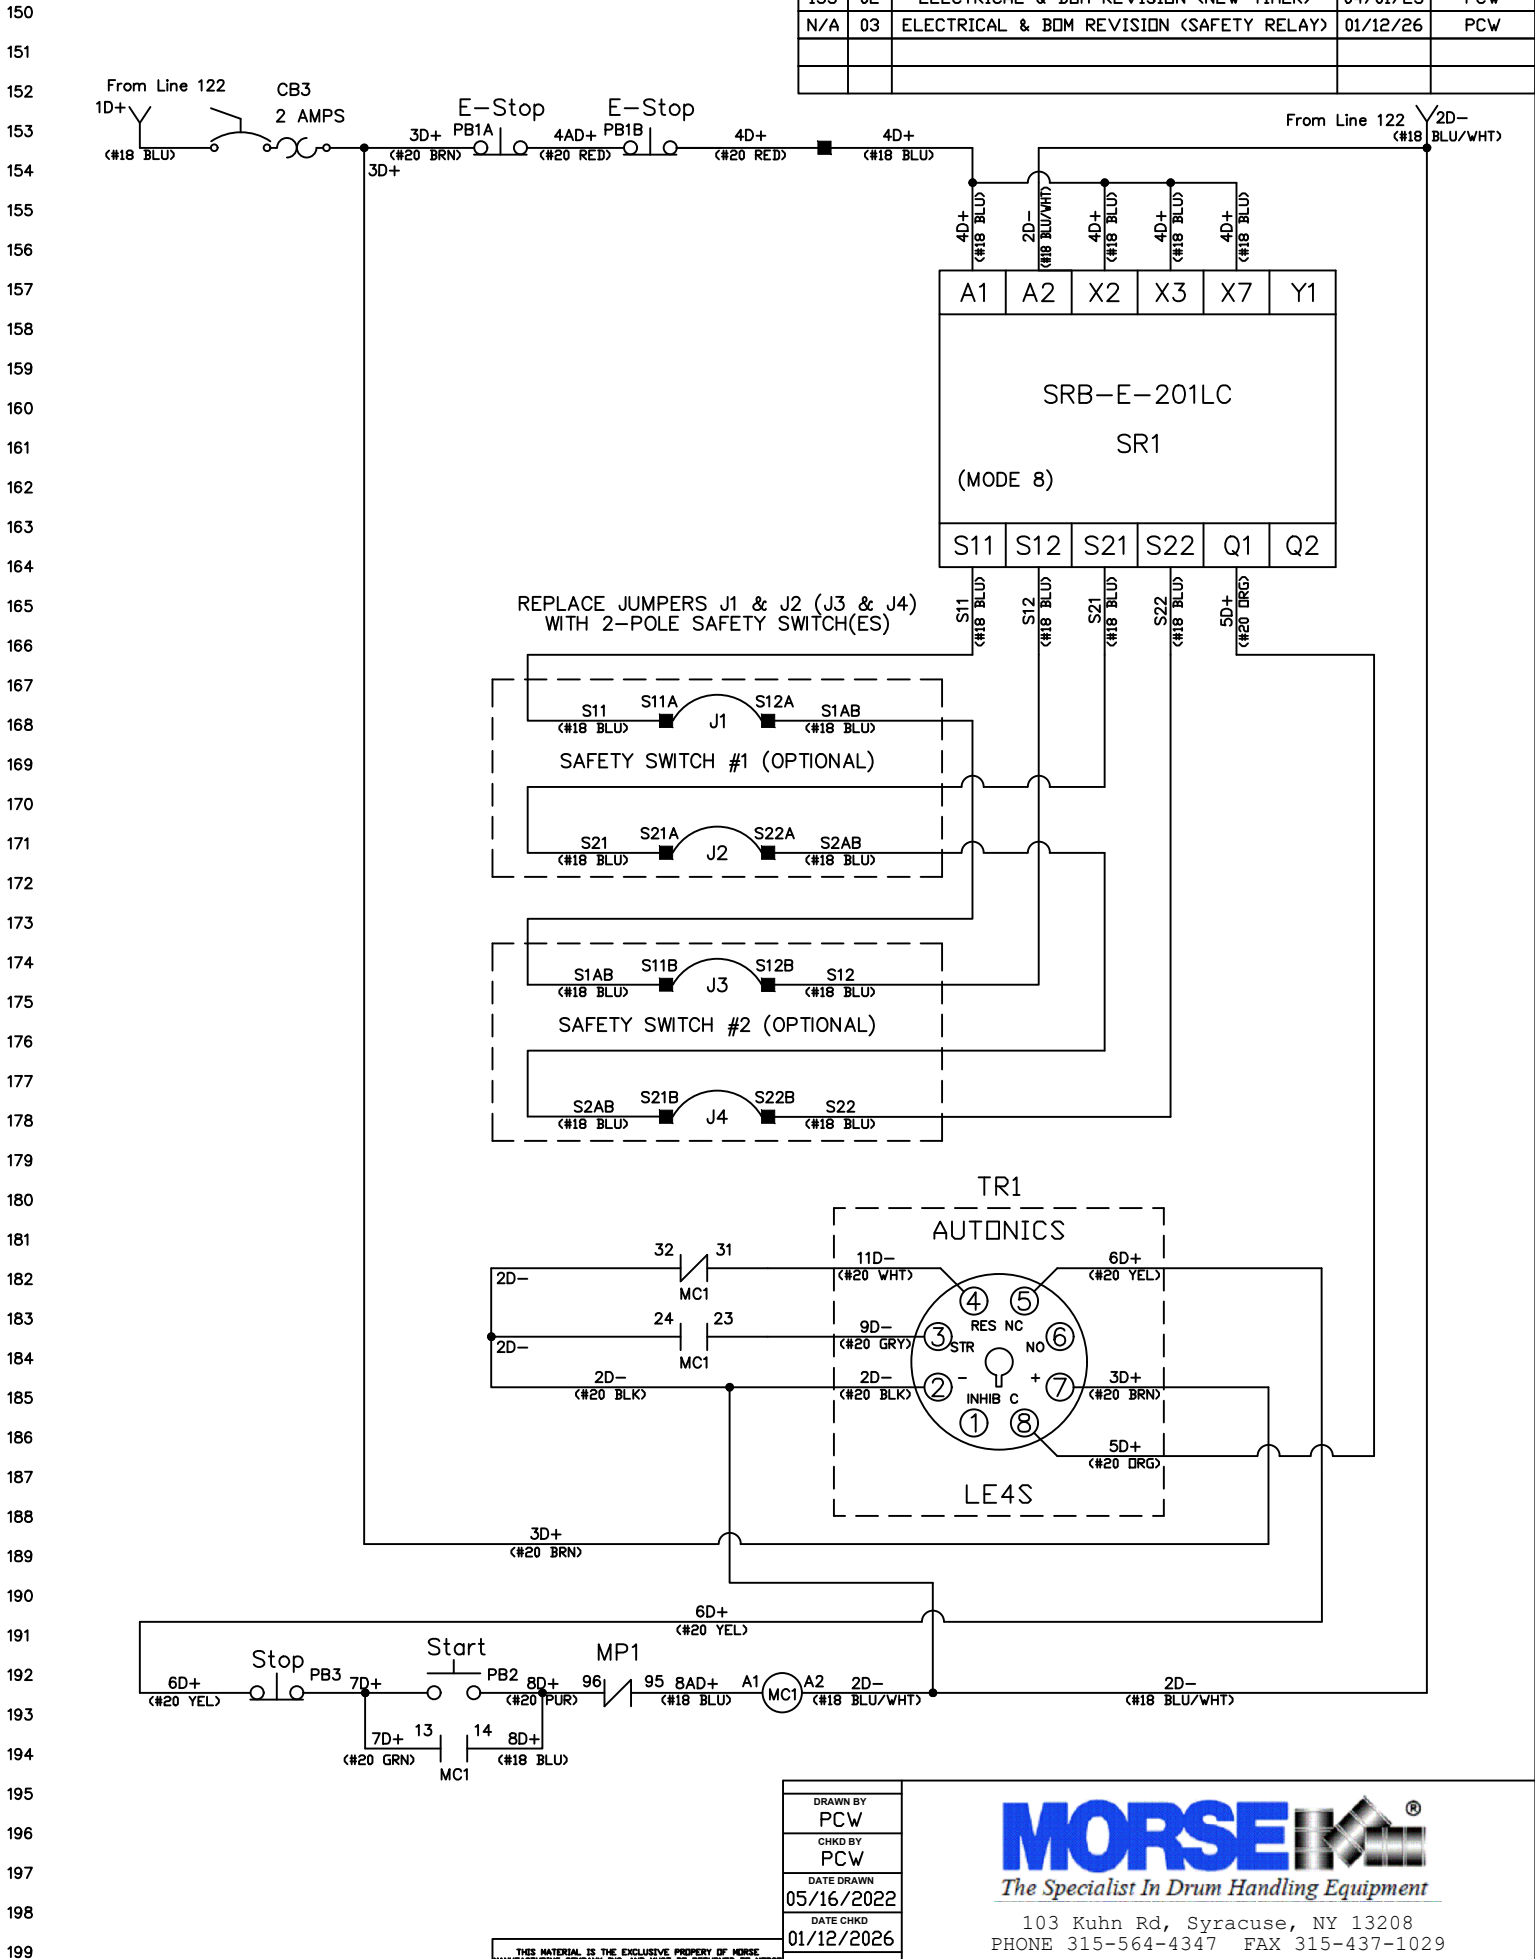

DRAWN BY
PCW

CHKD BY
PCW

DATE DRAWN
05/16/2022

DATE CHKD
01/12/2026

MORSE
The Specialist In Drum Handling Equipment

103 Kuhn Rd, Syracuse, NY 13208
PHONE 315-564-4347 FAX 315-437-1029

TITLE MORSE 6495-P (ELECTRICAL)

380-460VAC 50/60HZ 3PH 0.5HP

DWG NO.
AAC1051622A

SHEET
1 of 1

REV
03

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF MORSE MANUFACTURING COMPANY INC. AND MUST BE RETURNED TO MORSE IMMEDIATELY UPON REQUEST. THIS MATERIAL AND INFORMATION ILLUSTRATED OR CONTAINED HEREIN MAY NOT BE REPRODUCED, COPIED, USED, OR TRANSMITTED IN WHOLE OR IN PART IN ANY WAY WITHOUT THE PRIOR WRITTEN CONSENT OF MORSE MANUFACTURING COMPANY INC.