



CUSTOMER TO SUPPLY PROPERLY PROTECT
INCOMING POWER AS PER LOCAL CODES.
(USE 75C COPPER WIRE ONLY)

[INCOMING POWER
240V 1Ø 60HZ]

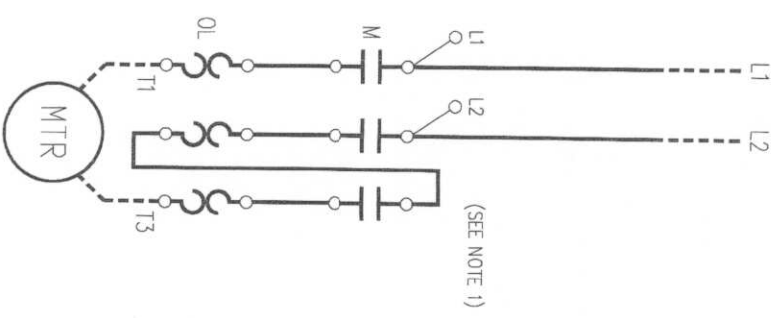

NON COMBINATION
11.5FLA

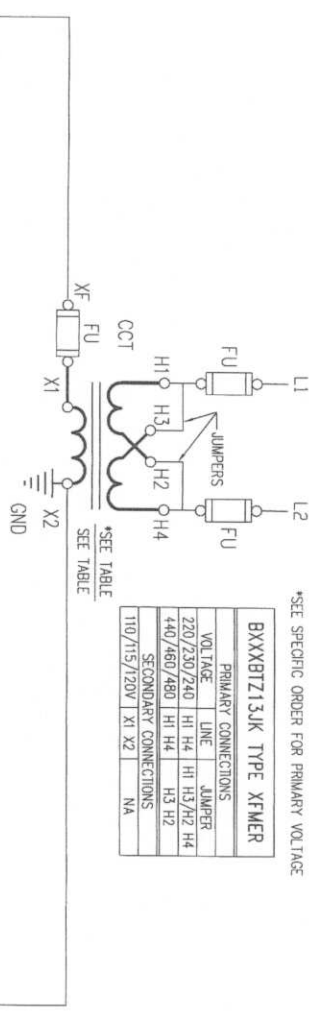

*SEE SPECIFIC ORDER FOR PRIMARY VOLTAGE


BXXXXT13JK TYPE XFEMER			
PRIMARY CONNECTIONS			
VOLTAGE	LINE	JUMPER	
220/230/240	H1 H4	H1 H3/H2 H4	
440/460/480	H1 H4	H3 H2	
SECONDARY CONNECTIONS			
110/115/120V	X1 X2	NA	

*SEE TABLE

NOTES:

- 1) SINGLE PHASE APPLICATIONS: 120VAC COILS AND ABOVE SHALL BE WIRED TO LINE SIDE L1 & L2.
- 2) TB JUMPER TO BE REMOVED IF INTERLOCK SWITCH IS USED.
- 3) X2 TERMINAL GROUNDED AS STANDARD, REMOVE IF NOT REQUIRED.

TERM. BLOCK DETAIL



NOTICE

THIS DRAWING IS THE CONFIDENTIAL PROPERTY OF SPRECHER-SCHUH INC and, as such, is subject to recall at any time. The drawing may not be reproduced, used or disclosed for any purpose except as authorized by Sprecher-Schuh Inc.

DRAWN BY:	MB
CHECKED BY:	MB
APPROVED BY:	MH
DATE	

CUSTOM CONTROL PANEL
FNVR W/ START/STOP
PART NUMBER - 3214C-P
AUBURN ARMATURE - MORSE MFG

sprecher+
schuh
HOUSTON,
SHEET 3 OF 3
DMG. NO.
CCP WS-615-1999